


NOTE:


1. LETTER ON COVER SHALL BE "S" WHEN USED IN SAN. SEWER SYSTEM AND "W" WHEN USED IN WATER SYSTEM.
2. RISER FOR VALVE BOX SHALL MATCH TYPE OF PIPE USED FOR MAIN.

GENERAL SPECIFICATIONS


1. CAST IRON SHALL BE 35,000 PSI
2. ASTM A48 CLASS 35B

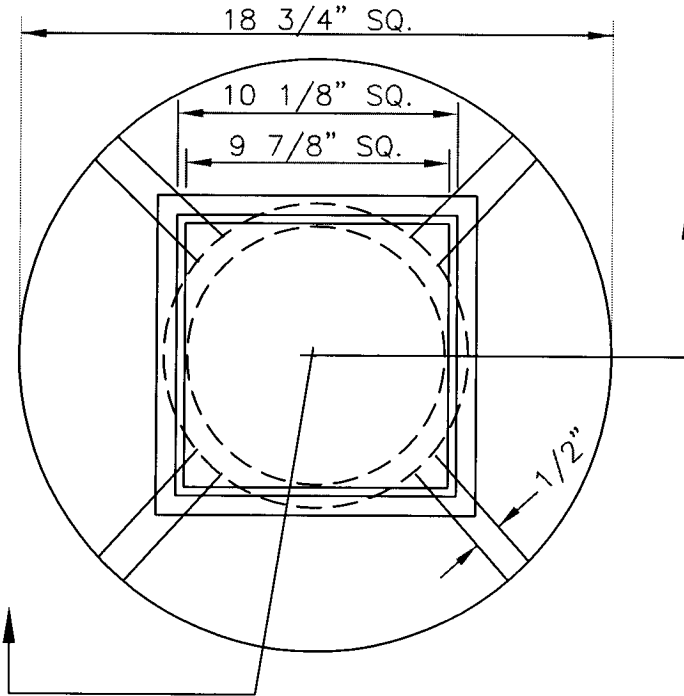


PLAN VIEW

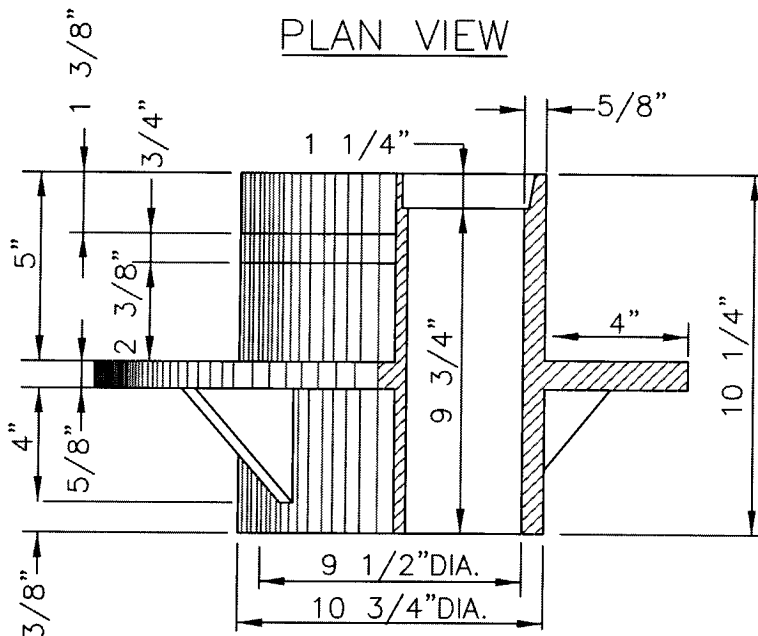

PROFILE
VALVE BOX

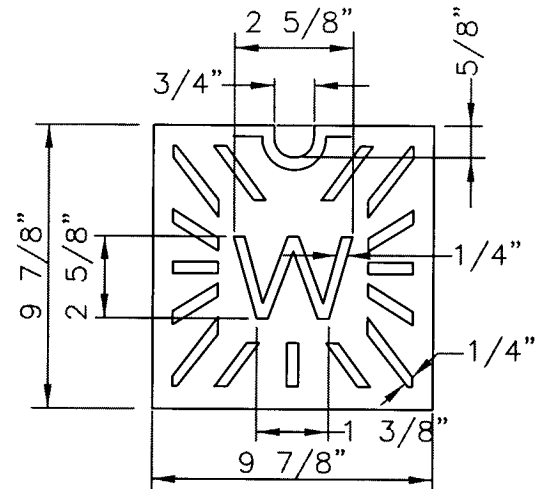

PLAN VIEW
VALVE LID

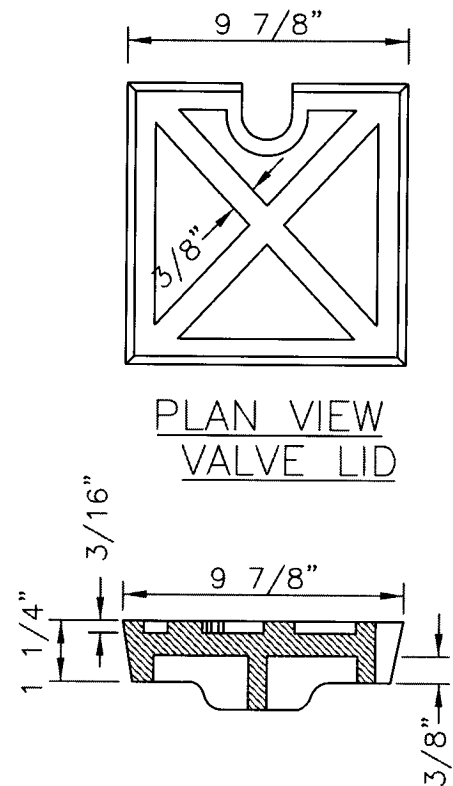

PROFILE
VALVE LID

CITY OF NORFOLK - DEPARTMENT OF UTILITIES
STANDARD DETAILS

SCALE:
NOT TO SCALE

LARGE GATE VALVE BOX
FOR MAINS 8 INCHES AND LARGER

DRAWING NO.
CS 5

DATE: 07/06